


The fire hydrants are UL Listed / FM Approved and are rated at 250 psi water working pressure. Available in a mechanical joint or flanged connection, 3 outlets, 2 for hose nozzle of 2-1/2" and one for pumper nozzle of 4" or 4-1/2"



Dry Barrel

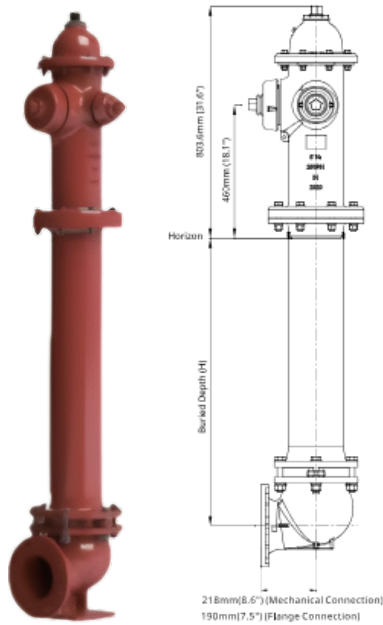

Wet Barrel

Technical Specification

Dry Barrel	
Design Standard	FM 1510/UL 246/AWWA C502
Coating Standard	AWWA C550
Nozzle Thread Standard	NFPA 1963
Hose Nozzle	2-1/2"-Two
Pumper Nozzle	4" or 4-1/2"-One
Mechanical Joint	Size: 6" ANSI/AWWA C111/A21.11 ANSI/AWWA C153/A21.53
Flange End	Size: 6" ANSI Class 125 / 150 BS EN 1092-2PN10/16
Working Pressure	250 PSI

Wet Barrel	
Design Standard	FM 1511/UL 246/AWWA C503
Coating Standard	AWWA C550
Hose Nozzle	2.5" *2
Pumper Nozzle	4.5" or 4" *1
Nozzle Standard	NFPA 1963
Monitor Flange	Size:4"-ANSI Class 125
Inlet Flange Connection	Size: 6" ANSI Class 125 /150 BS EN 1092-2PN10/16
Working Pressure	250 PSI

Select burial depth for Dry Barrel Fire Hydrants

Buried Depth (H)												
Inch	1"	2"	3"	3"-6"	4"-0"	4"-6"	5"-0"	5"-6"	6"-0"	6"-6"	7"-0"	
mm	326	543	848	1001	1153	1306	1458	1611	1763	1916	2068	